


Trump International Hotel - Real Power


7/15/2014 3:20:44 PM - 7/15/2014 4:25:30 PM

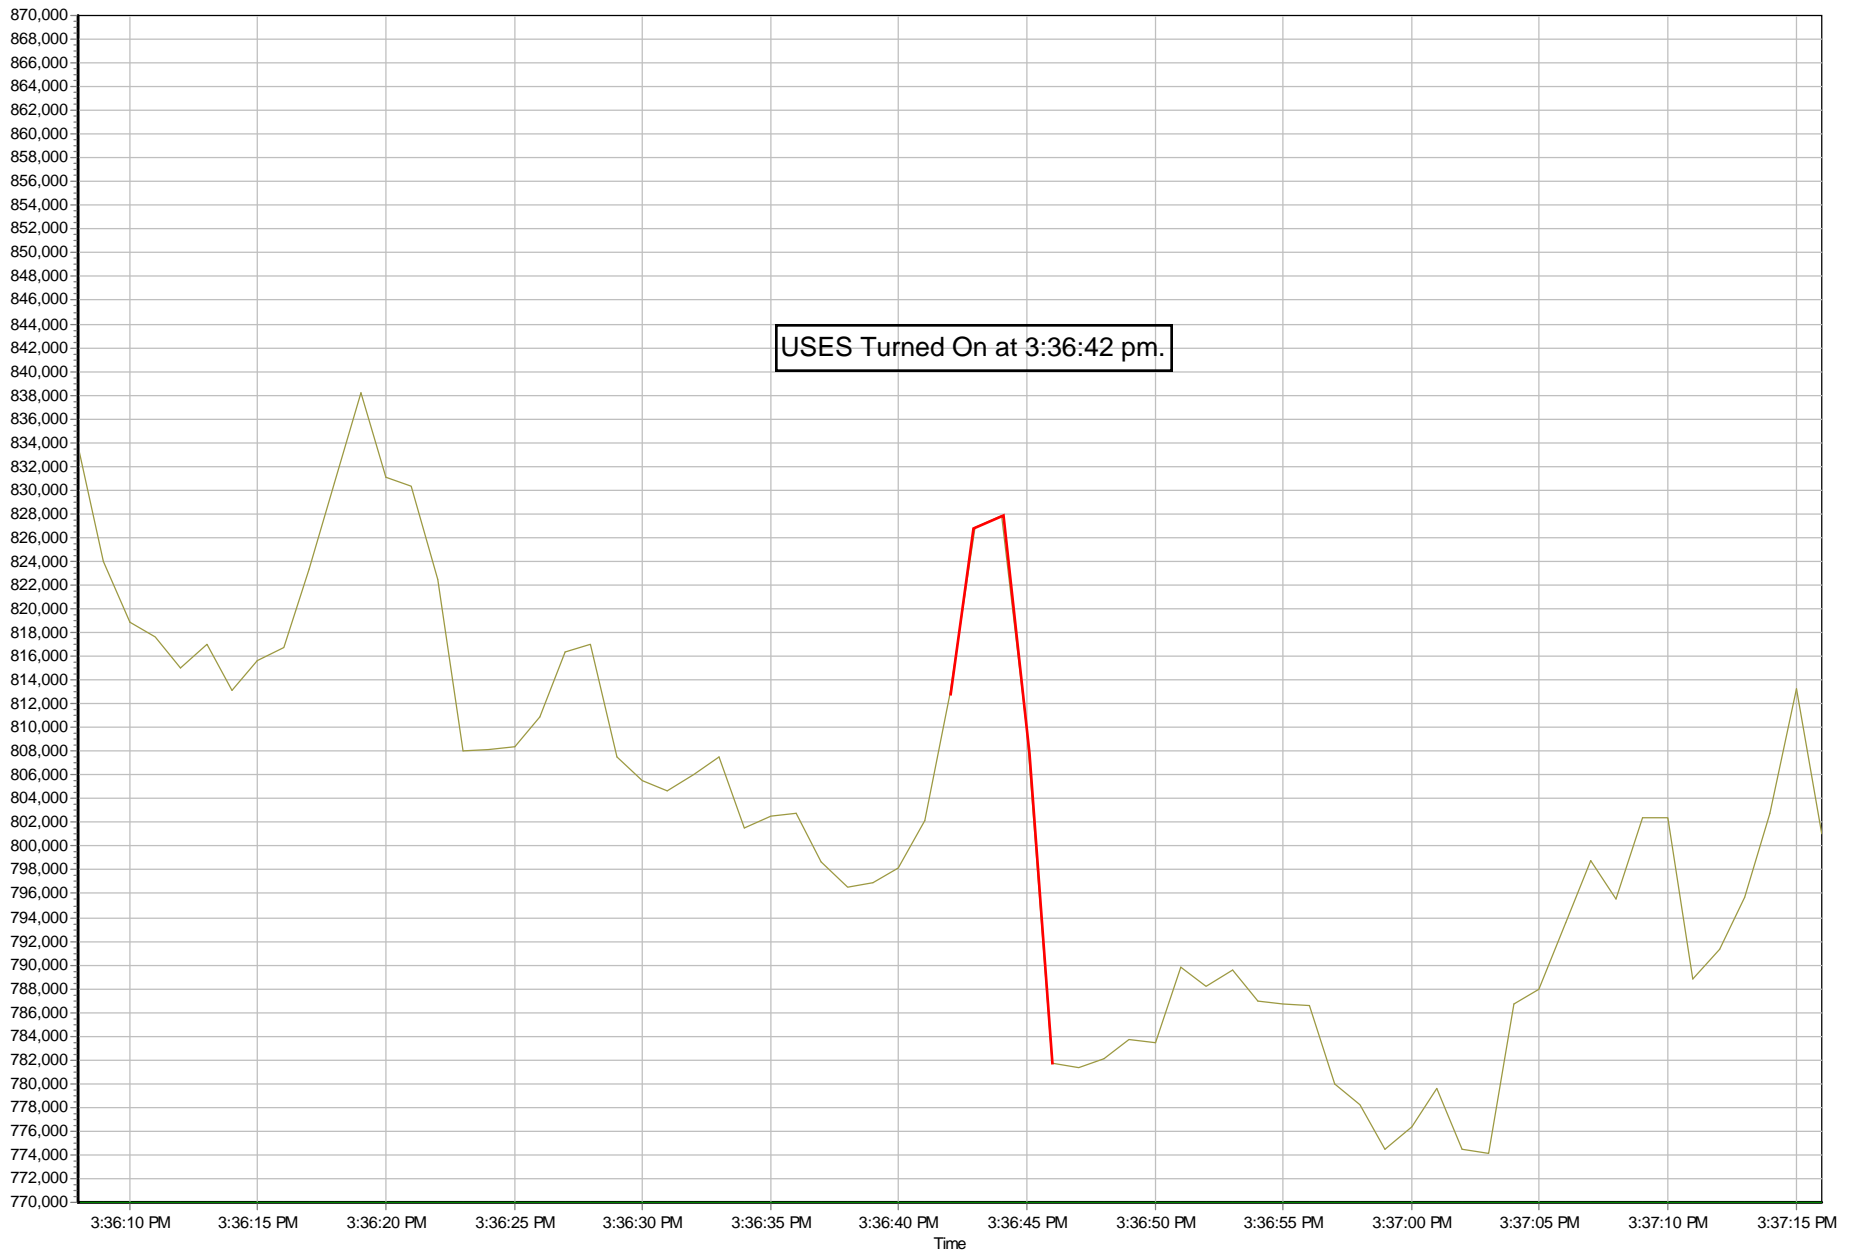

Real Power Total (823930.00 W, min:774143.75 W; max:838227.06 W; avg:802357.83 W)

Trump International Hotel - Apparent Power

7/15/2014 3:20:44 PM - 7/15/2014 4:25:30 PM

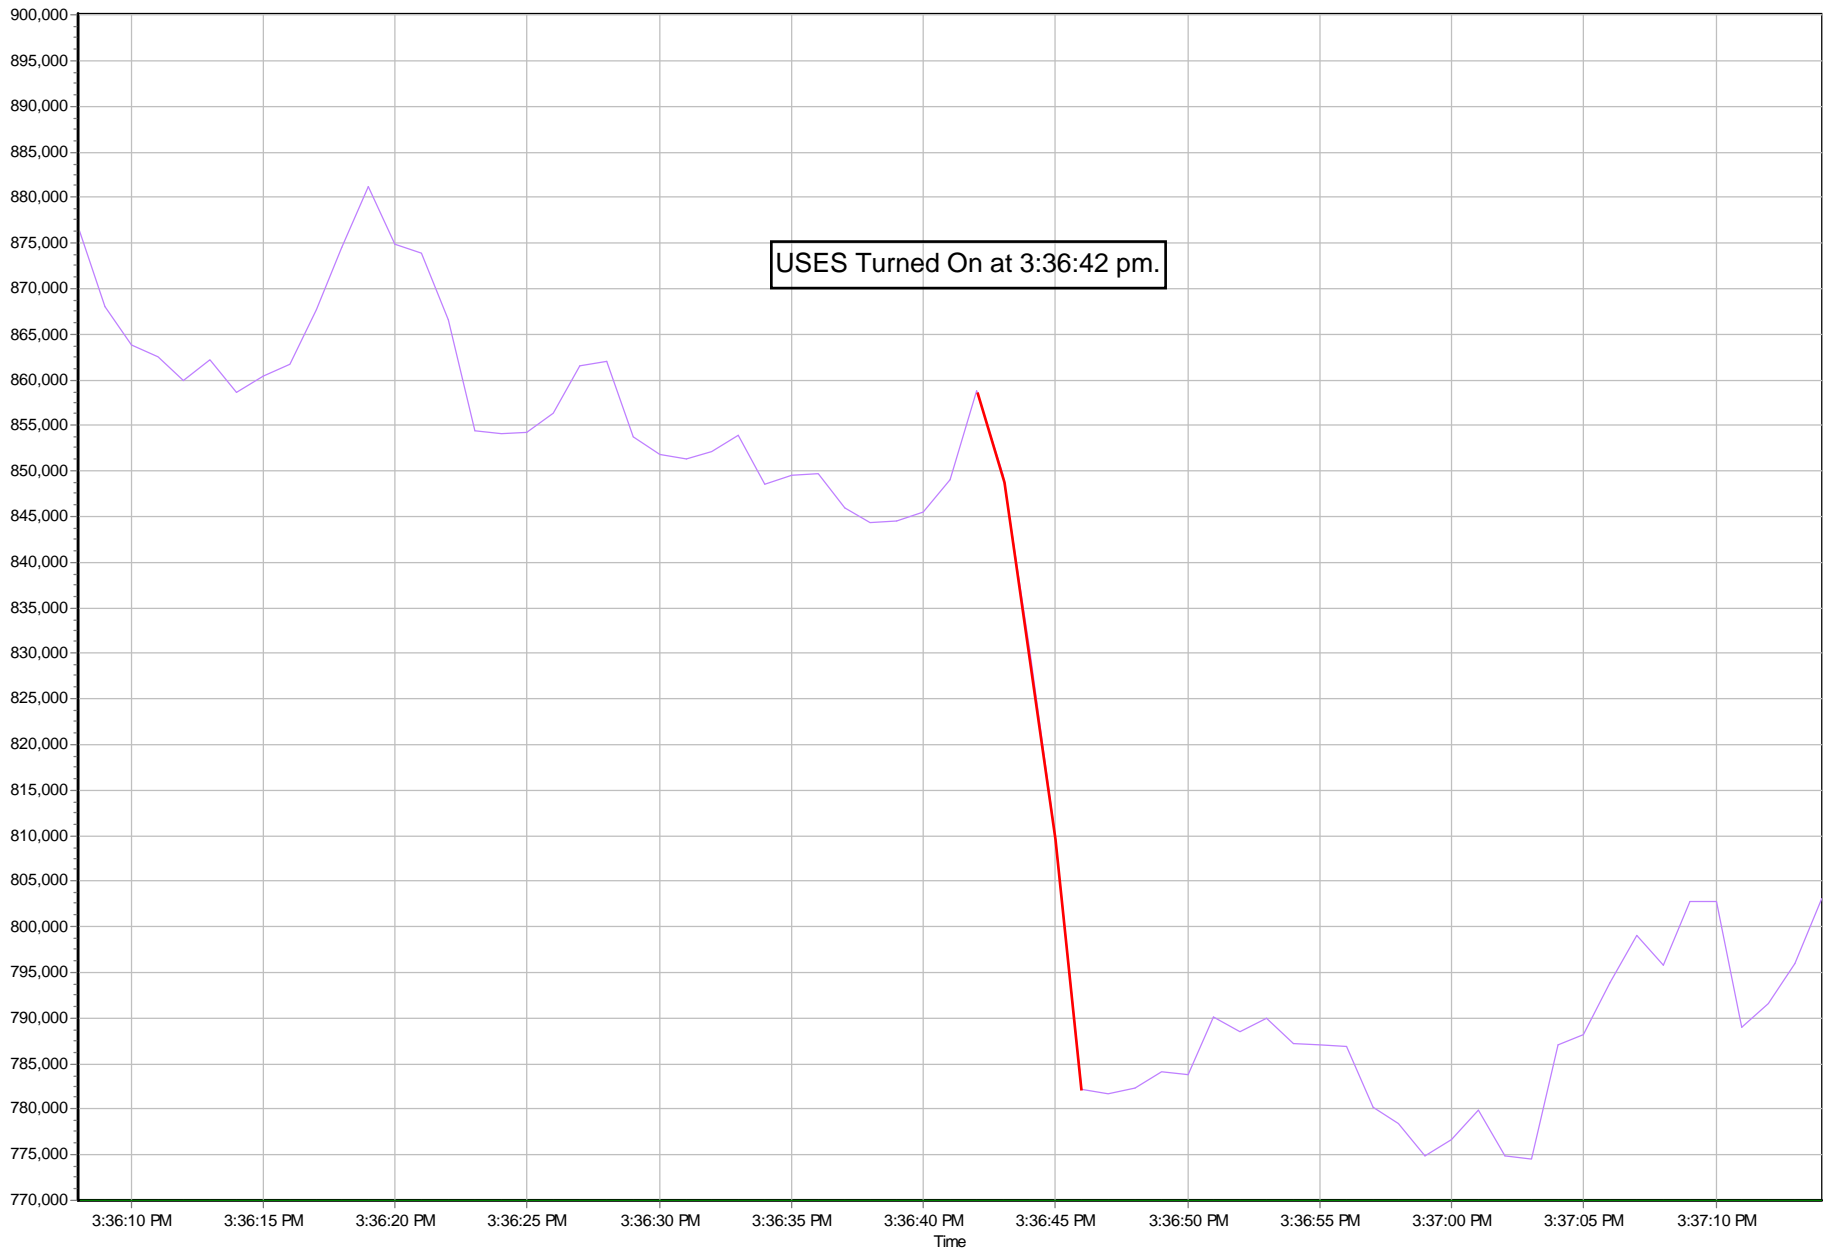

Apparent Power Total (853745.81 VA, min:774482.88 VA; max:881277.81 VA; avg:826548.76 VA)

Trump International Hotel - Reactive Power


7/15/2014 3:20:44 PM - 7/15/2014 4:25:30 PM



Reactive Power Total (276269.84 VAR, min:19809.22 VAR; max:279798.72 VAR; avg:154380.37 VAR)

Trump International Hotel - Power Factor


7/15/2014 3:20:44 PM - 7/15/2014 4:25:30 PM

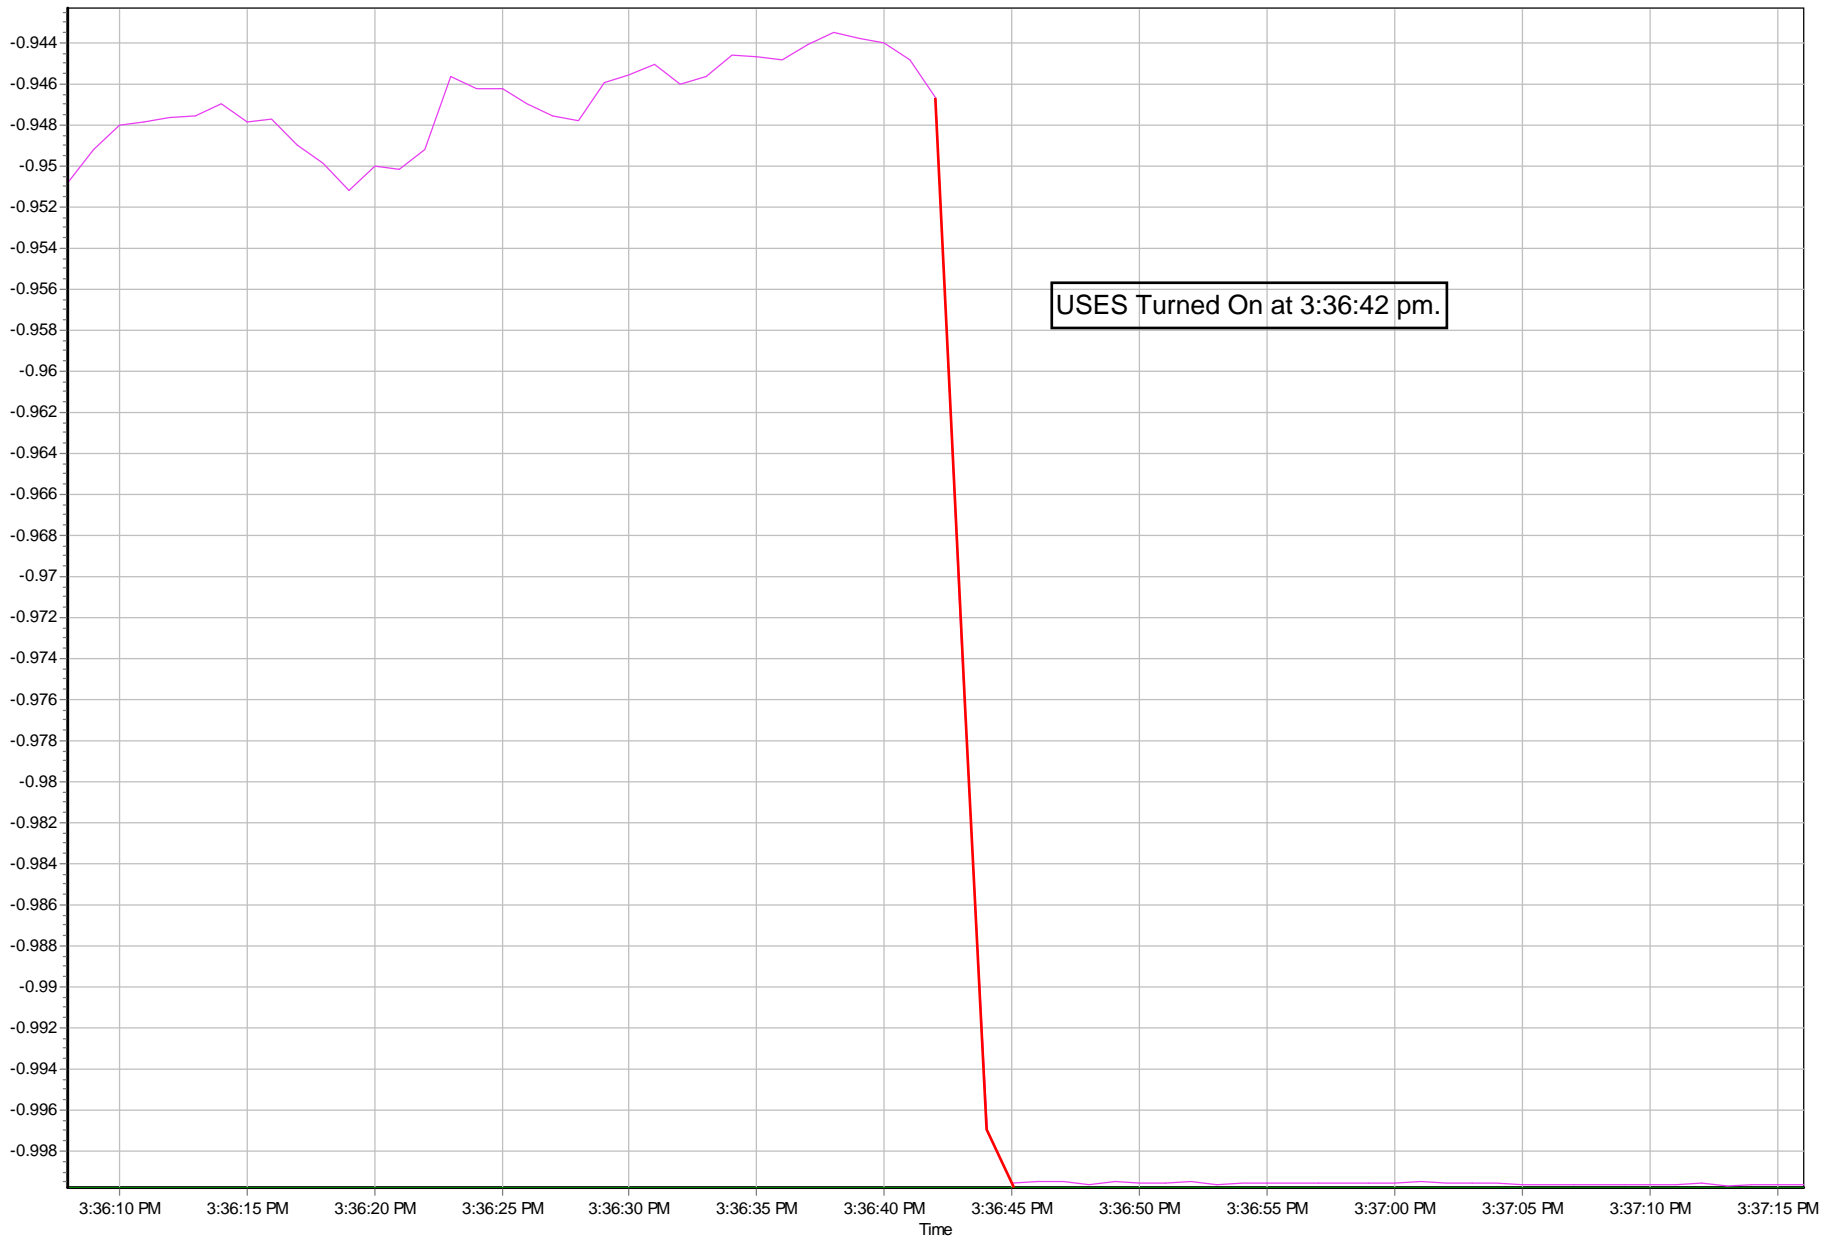

True Power Factor Total (0.951, min:1.000; max:0.941; avg:0.971)

Trump International Hotel - RMS Current

7/15/2014 3:20:44 PM - 7/15/2014 4:25:30 PM

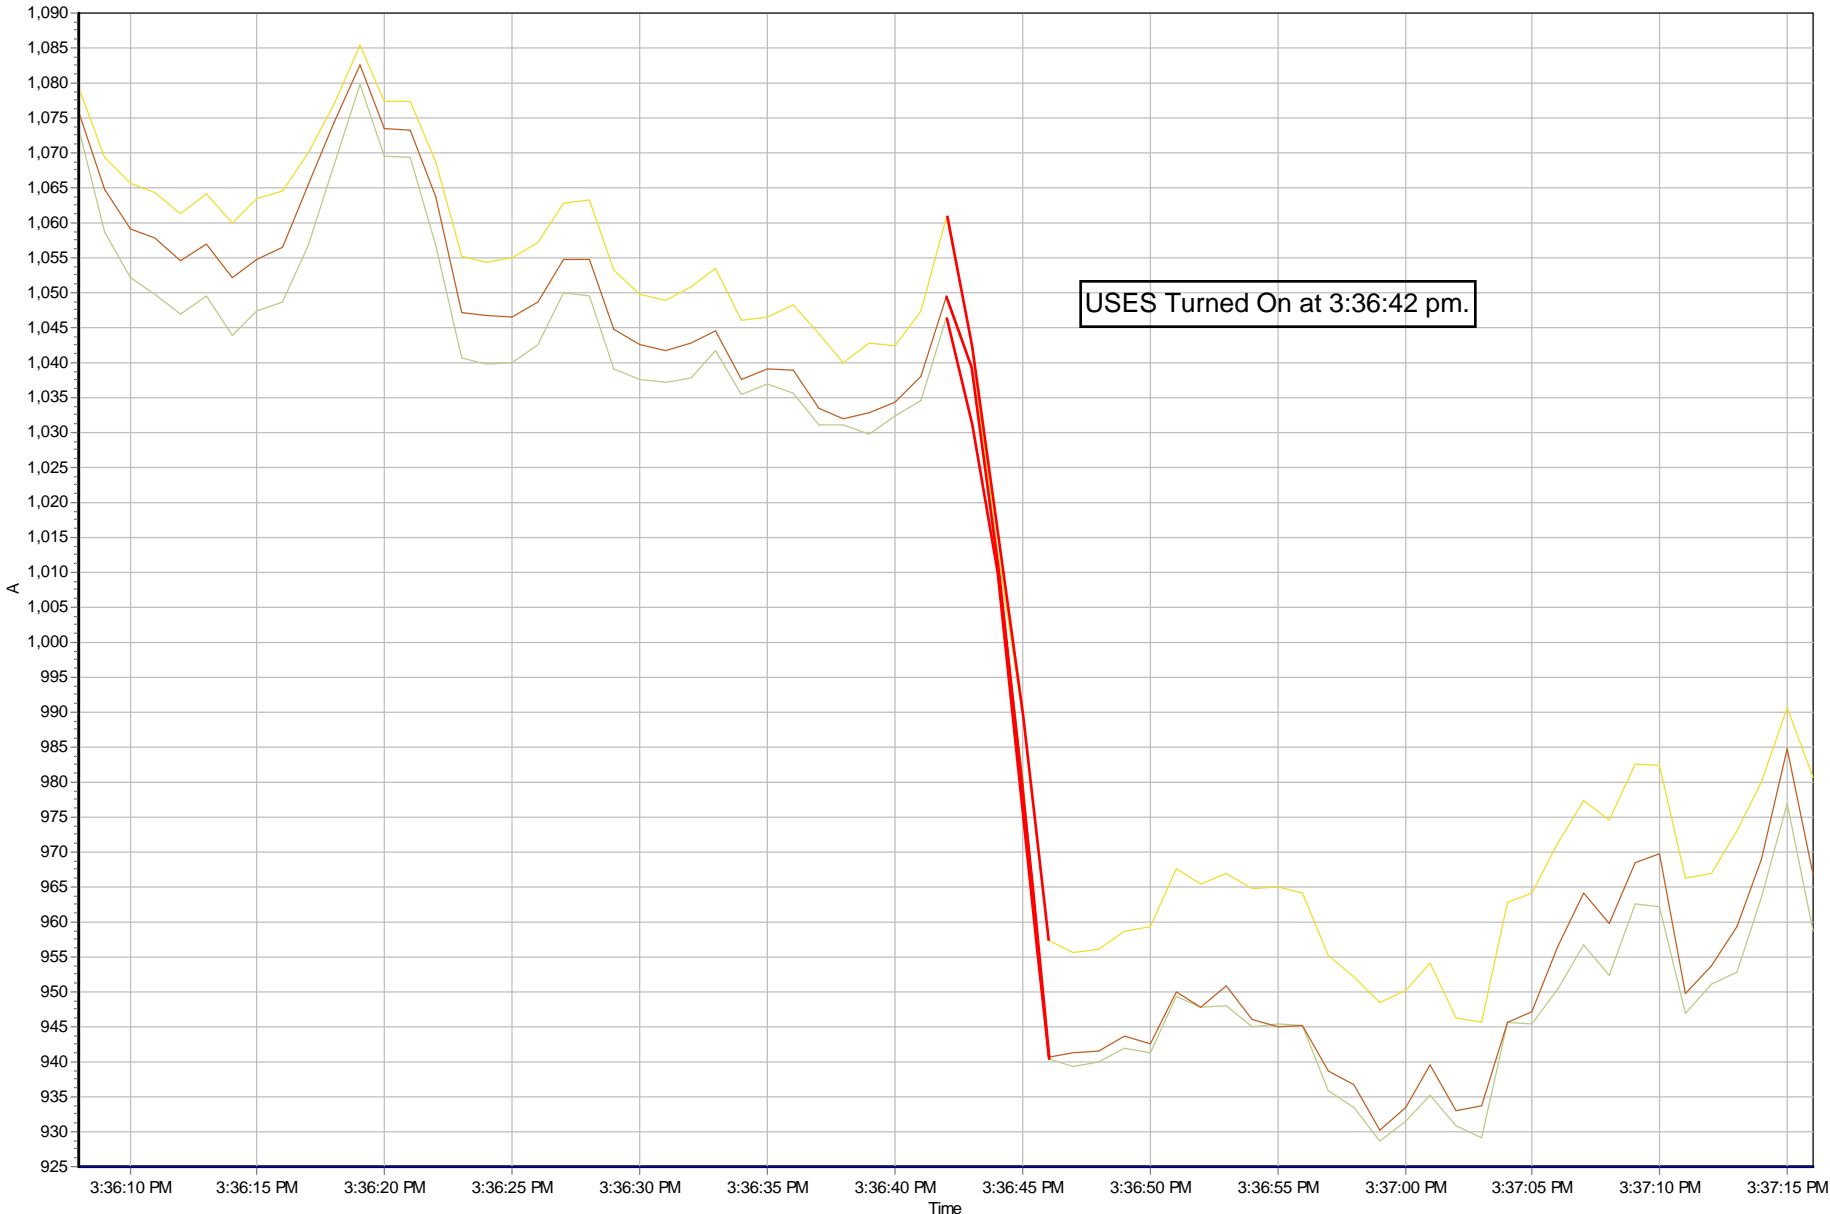

USES Turned On at 3:36:42 pm.

RMS Current Ø1 (1035.44 A, min:928.76 A; max:1079.86 A; avg:999.91 A) RMS Current Ø2 (1046.01 A, min:945.74 A; max:1085.36 A; avg:1014.83 A)
 RMS Current Ø3 (1037.72 A, min:930.28 A; max:1082.72 A; avg:1004.13 A)

Trump International Hotel - RMS Voltage

7/15/2014 3:20:44 PM - 7/15/2014 4:25:30 PM

